


VALLEY GUTTER ACROSS INTERSECTION

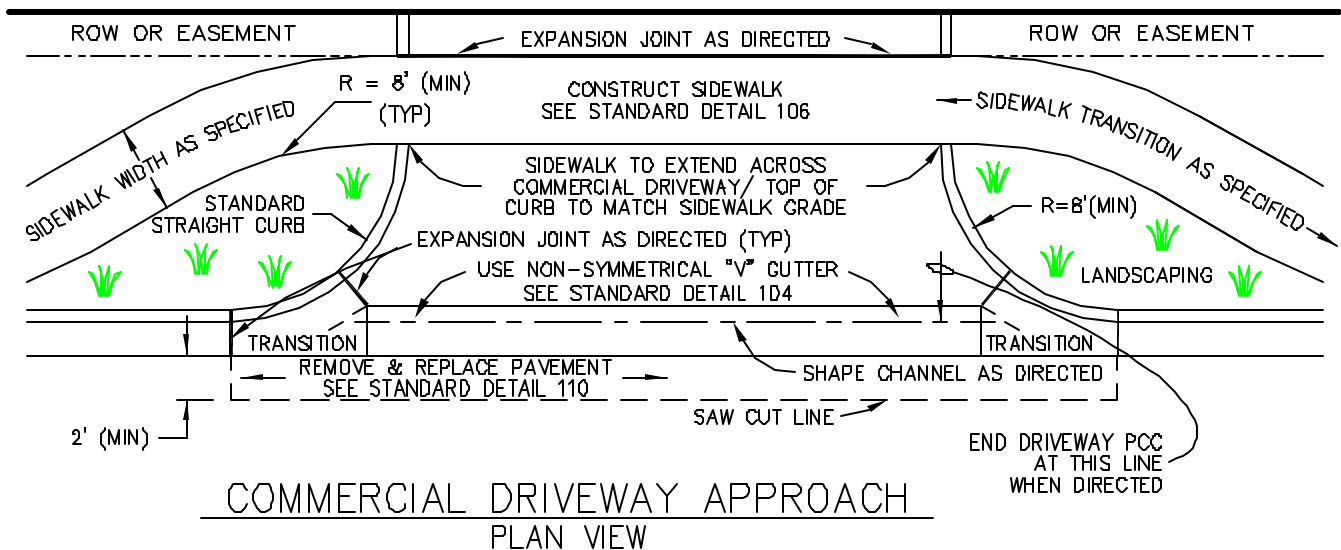

NOTES:

1. CONSTRUCT CURBING MONOLITHIC WITH FILLET AND INSTALL SIDEWALK RAMPS AS DESIGNATED ON THE PLANS.
2. PCC SHALL ATTAIN A 28-DAY MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI.
3. ALL SIDEWALK CURVES WILL HAVE 8' (MIN) RADI

CITY OF CORVALLIS

ENGINEERING DIVISION

VALLEY GUTTER ACROSS INTERSECTION & STANDARD COMMERCIAL DRIVEWAY APPROACH

DATE: JANUARY, 2003

SCALE: NONE

STANDARD DETAIL No.

APPROVED:

[Signature]

109